

Ronald Beyer  
Architect

Lakeside Plaza  
2515 Park Marina Drive  
Suite 205

Post Box 1154  
Redding, Ca 96099

530 241 7067


Photovoltaic Panel  
Structure and  
Parking Addition

for The


Shasta  
Community  
Health  
Center

Located at

1035 Placer Street  
Redding, Ca

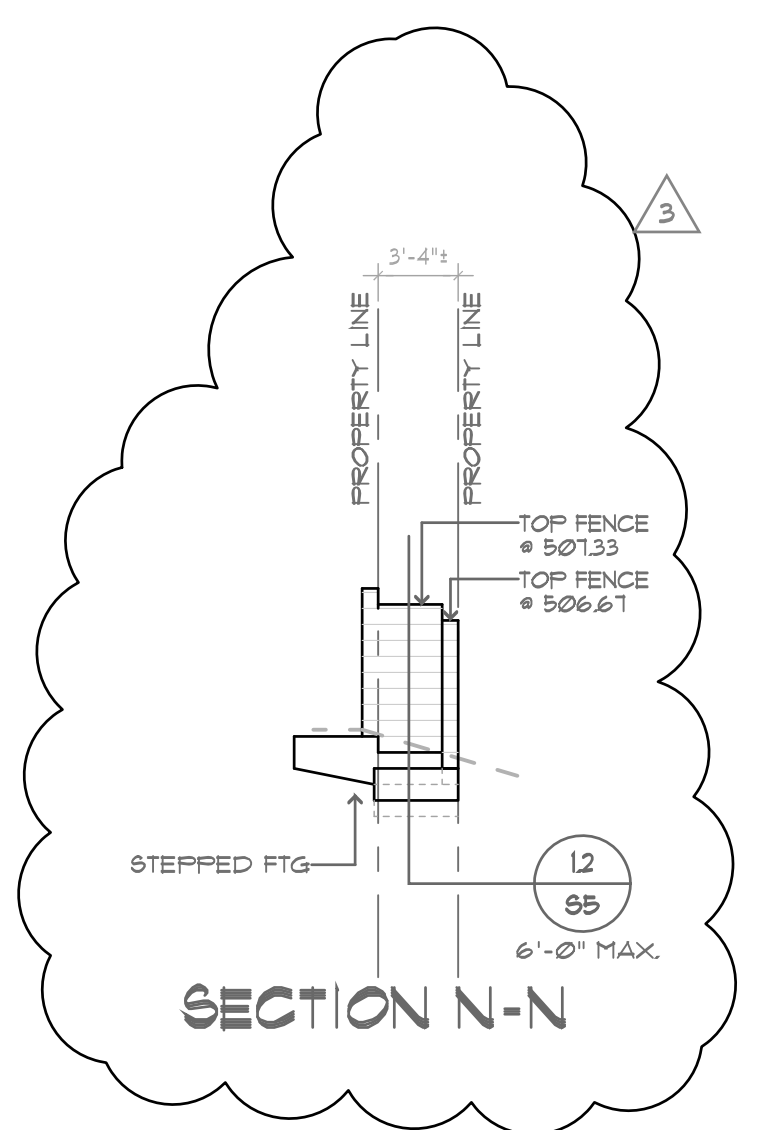


SECTION N-N

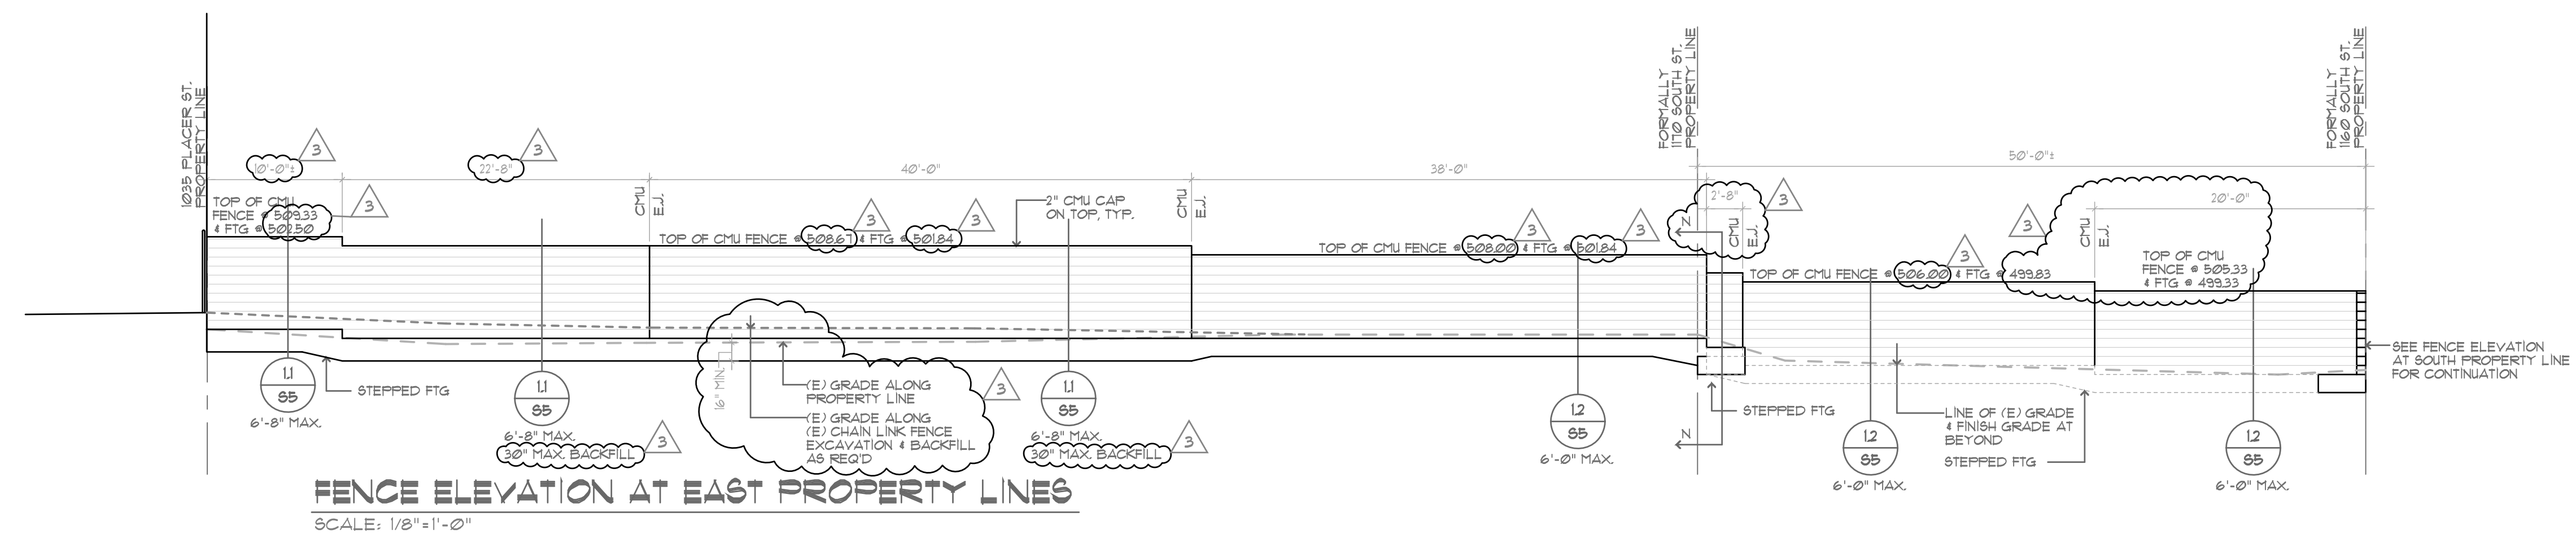


FENCE ELEVATION AT EAST PROPERTY LINES

SCALE: 1/8"=1'-0"

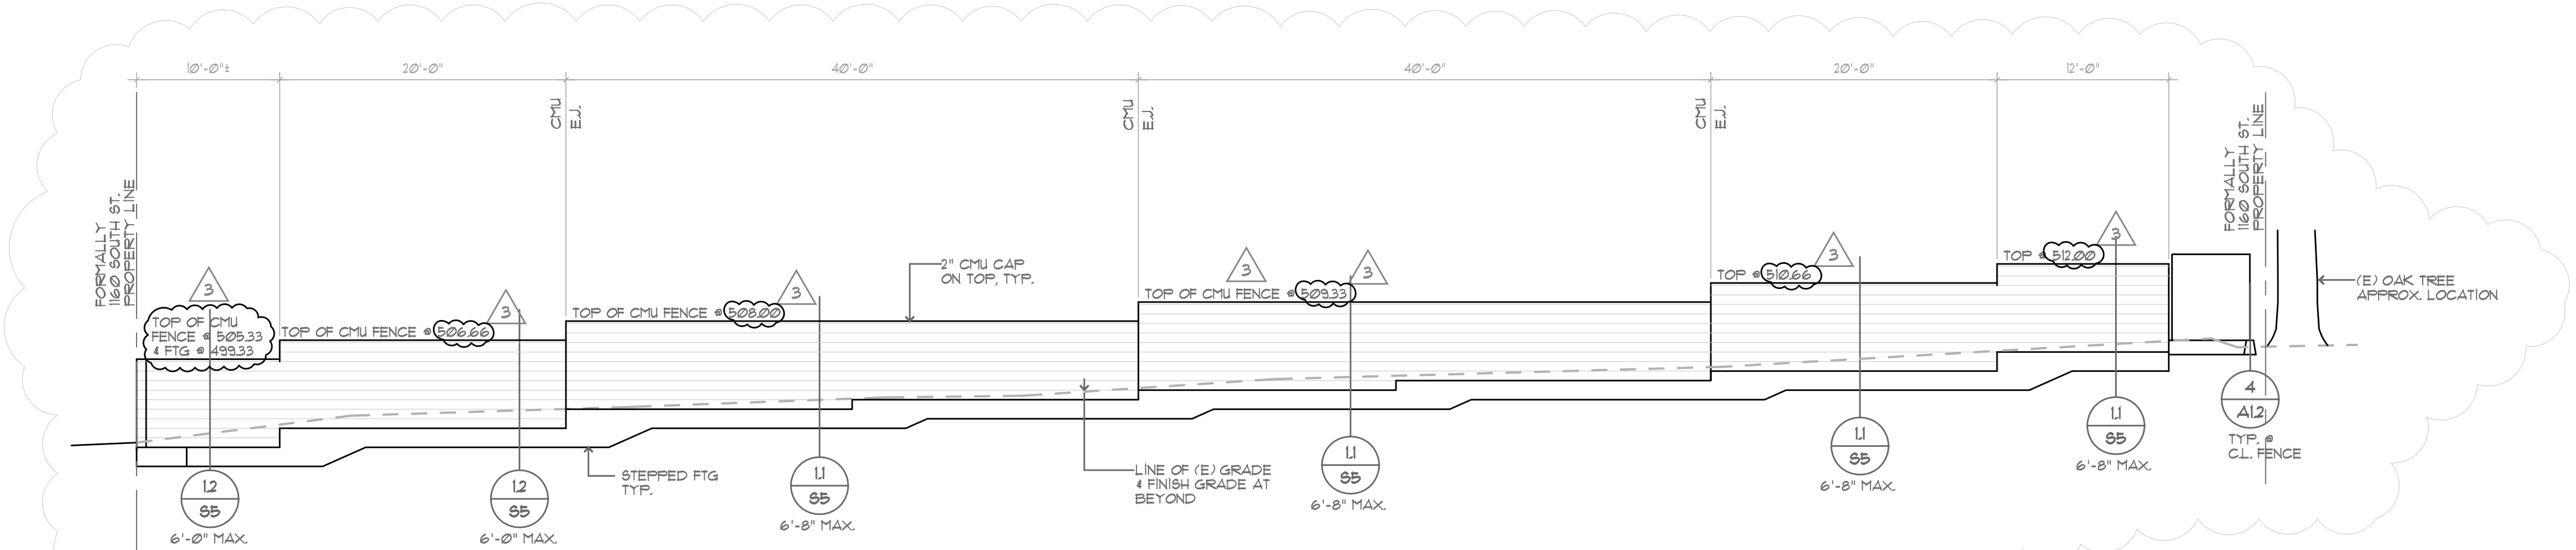

FENCE ELEVATION AT SOUTH PROPERTY LINE


SCALE: 1/8"=1'-0"

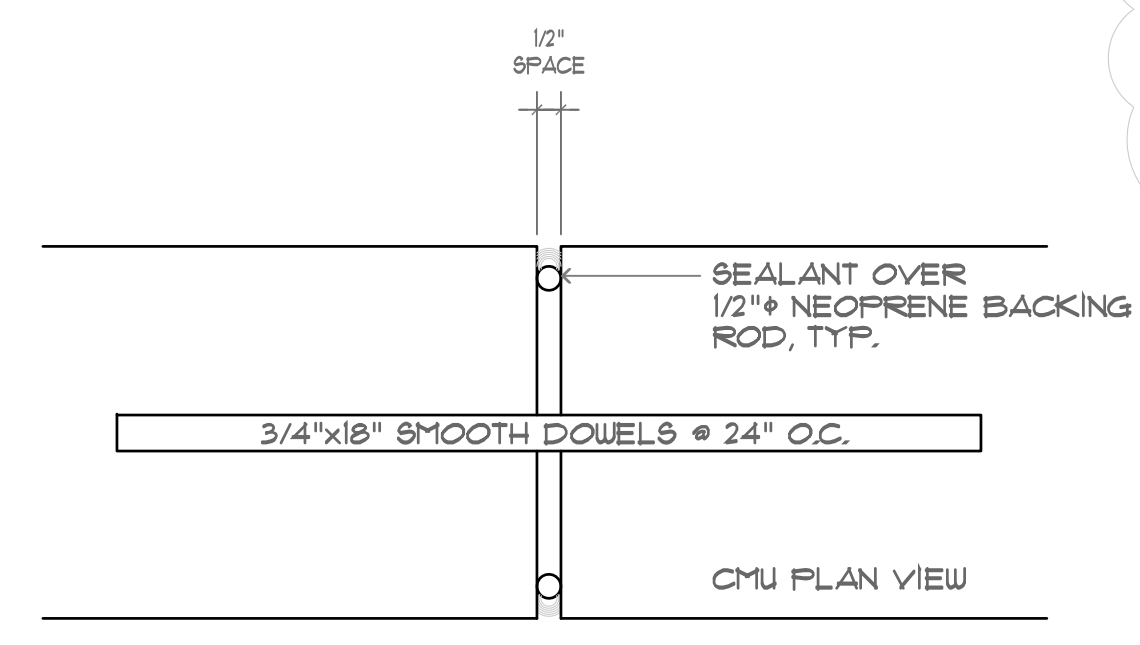


CMU EXPANSION DETAIL  
NO SCALE

CMU NOTES

- SPECIAL INSPECTION WAIVED FOR CONSTRUCTION OF CMU FENCE WALLS
- ALL MASONRY MATERIALS AND WORK SHALL COMPLY WITH THE REQUIREMENTS OF CHAPTER 21, CBC.
- CONCRETE BLOCK UNITS SHALL BE HOLLOW CONCRETE UNITS, ASTM C90, GRADE 'N' UNITS. SOLID GROUT ALL CELLS.  $f_m = 1500$  psi
- MORTAR: TYPE S (1800 PSI MINIMUM) PER CBC 2103.8
- GROUT: COARSE GROUT, 2000 PSI MINIMUM, CBC 2103.12. MAXIMUM GROUT LIFT OF FIVE FEET.
- REINFORCING SHALL CONFORM TO ASTM A-615 GRADE 40, U.O.N.
- DOUELS SHALL BE STRAIGHT AND PLUMB. LAP ALL BARS 24" @ #4 // 30" @ #5.
- BEFORE BLOCK IS PLACED ON CONCRETE, THOROUGHLY CLEAN CONCRETE OF ALL LAITANCE AND ALL LOOSE MATERIAL. ROUGHEN AS IN A CONCRETE CONSTRUCTION JOINT.
- CONCRETE BLOCK MASONRY SHALL BE BUILT WITH A RUNNING BOND & PRESERVE THE UNOBSTRUCTED CONTINUITY OF THE VERTICAL CELLS TO BE FILLED. WALLS AND CROSS WEBS FORMING SUCH CELLS TO BE FILLED SHALL BE FULL BEDDED IN MORTAR TO PREVENT LEAKAGE OF GROUT. ALL HEAD OR END JOINTS SHALL BE SOLIDLY FILLED WITH MORTAR FOR A DISTANCE IN FROM THE FACE OF THE WALL OR UNIT NOT LESS THAN THE THICKNESS OF THE LONGITUDINAL FACE SHELLS. BOND SHALL BE PROVIDED BY LAPPING SUCCESSIVE COURSES.
- VERTICAL CELLS TO BE FILLED SHALL HAVE VERTICAL ALIGNMENT SUFFICIENT TO MAINTAIN A CLEAN, UNOBSTRUCTED CONTINUOUS VERTICAL CELL.
- VERTICAL REINFORCING SHALL BE HELD IN POSITION AT TOP AND BOTTOM.
- WHEN GROUTING IS STOPPED FOR ONE HOUR OR LONGER, HORIZONTAL CONSTRUCTION JOINTS SHALL BE FORMED BY STOPPING THE POUR OF GROUT 1-1/2" BELOW THE TOP OF THE UPPERMOST UNIT.
- THOROUGHLY CLEAN ALL CELLS AND BOND BEAMS OF MORTAR BEFORE GROUTING.
- PLACE ALL HORIZONTAL BARS IN BOND BEAM UNITS.

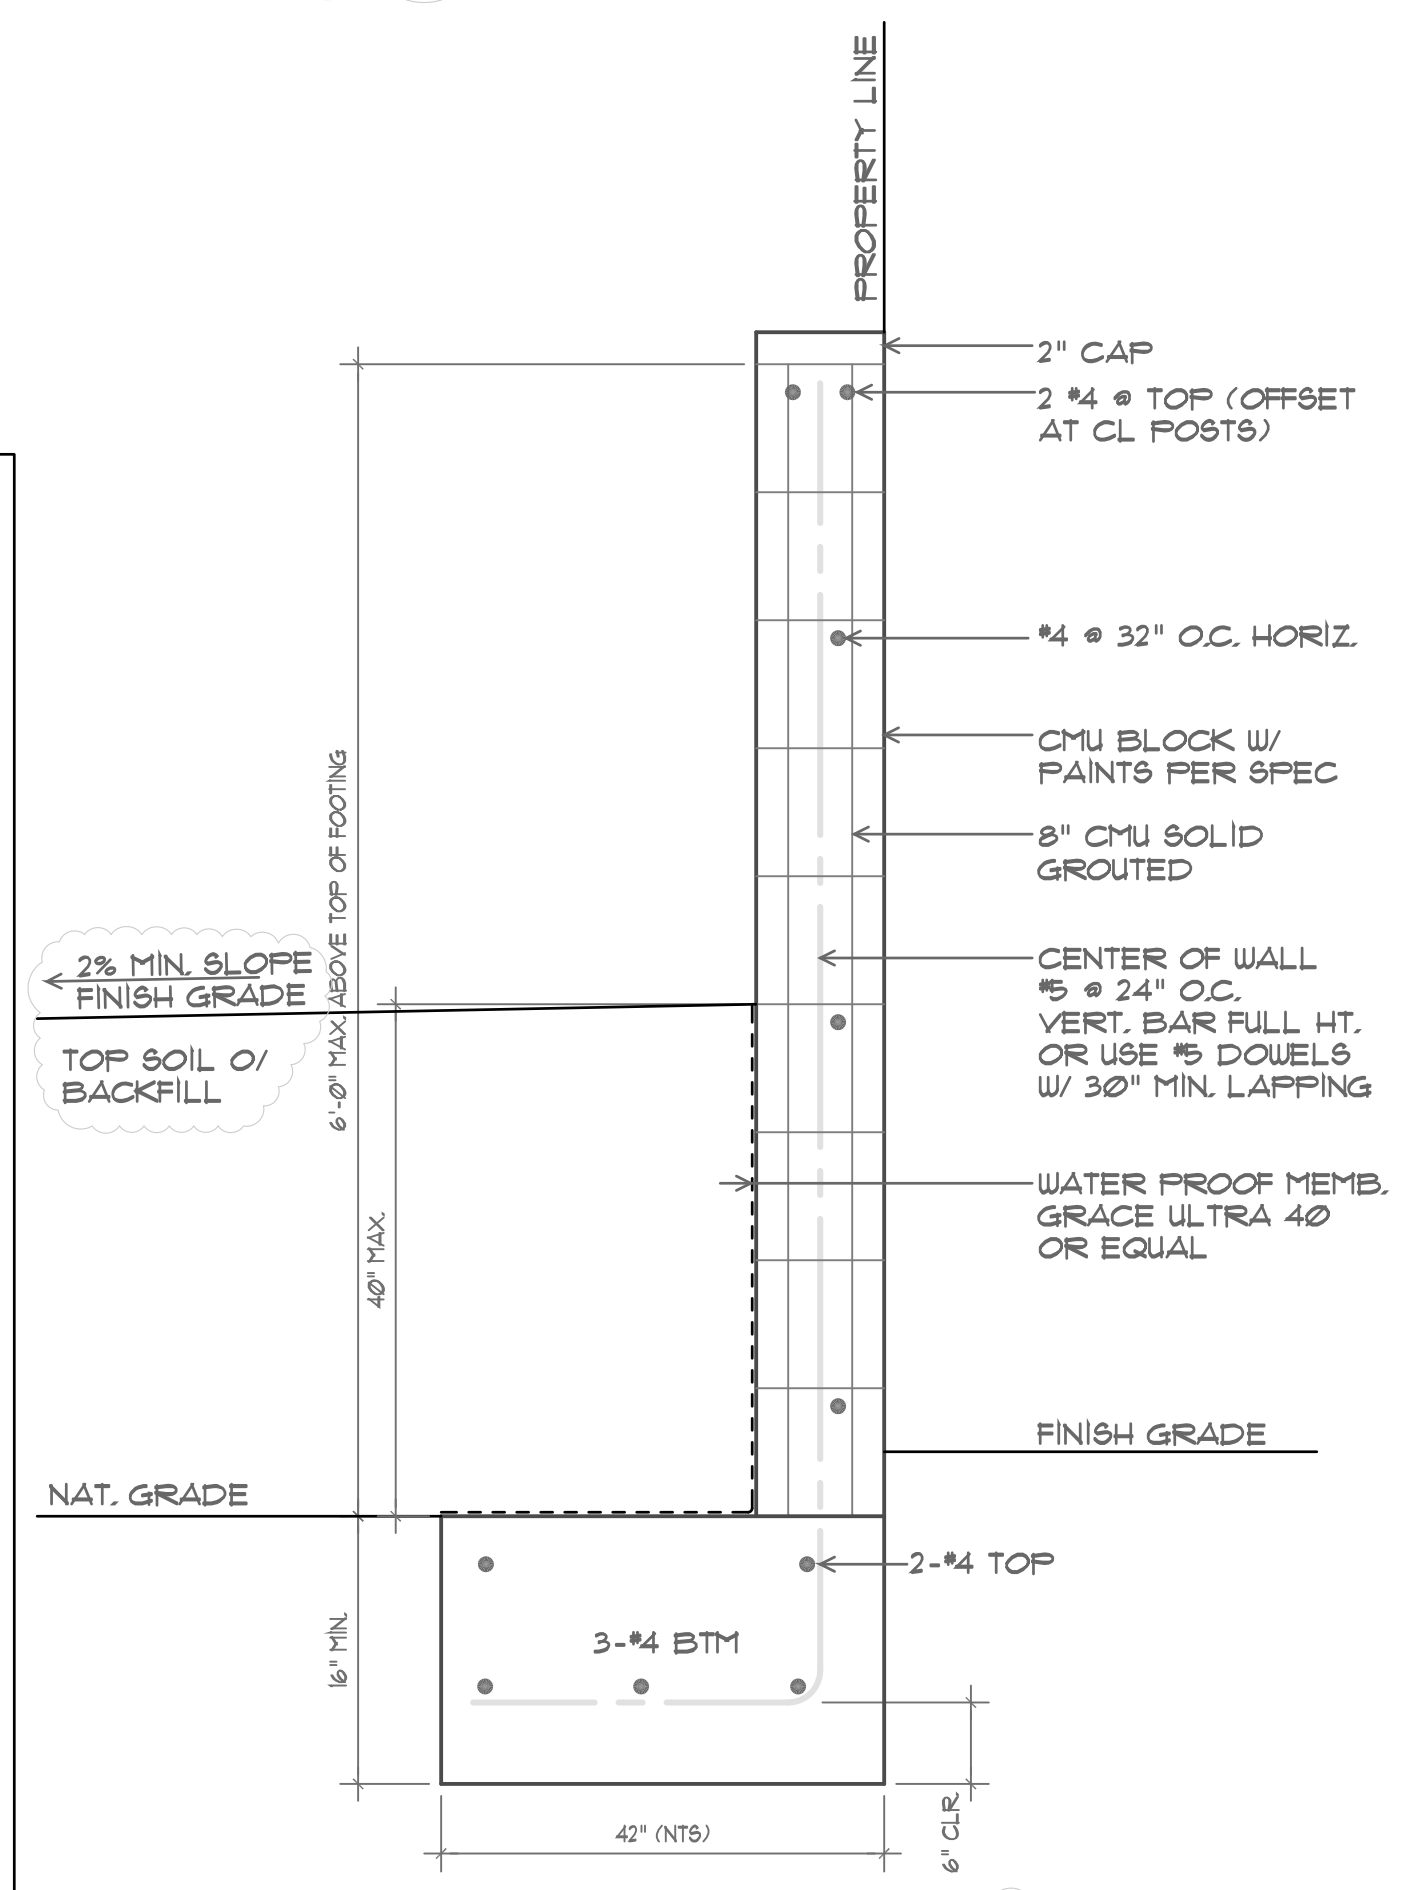

6' TALL CMU FENCE / RETAINING WALL  
SCALE: 1"=1'-0"

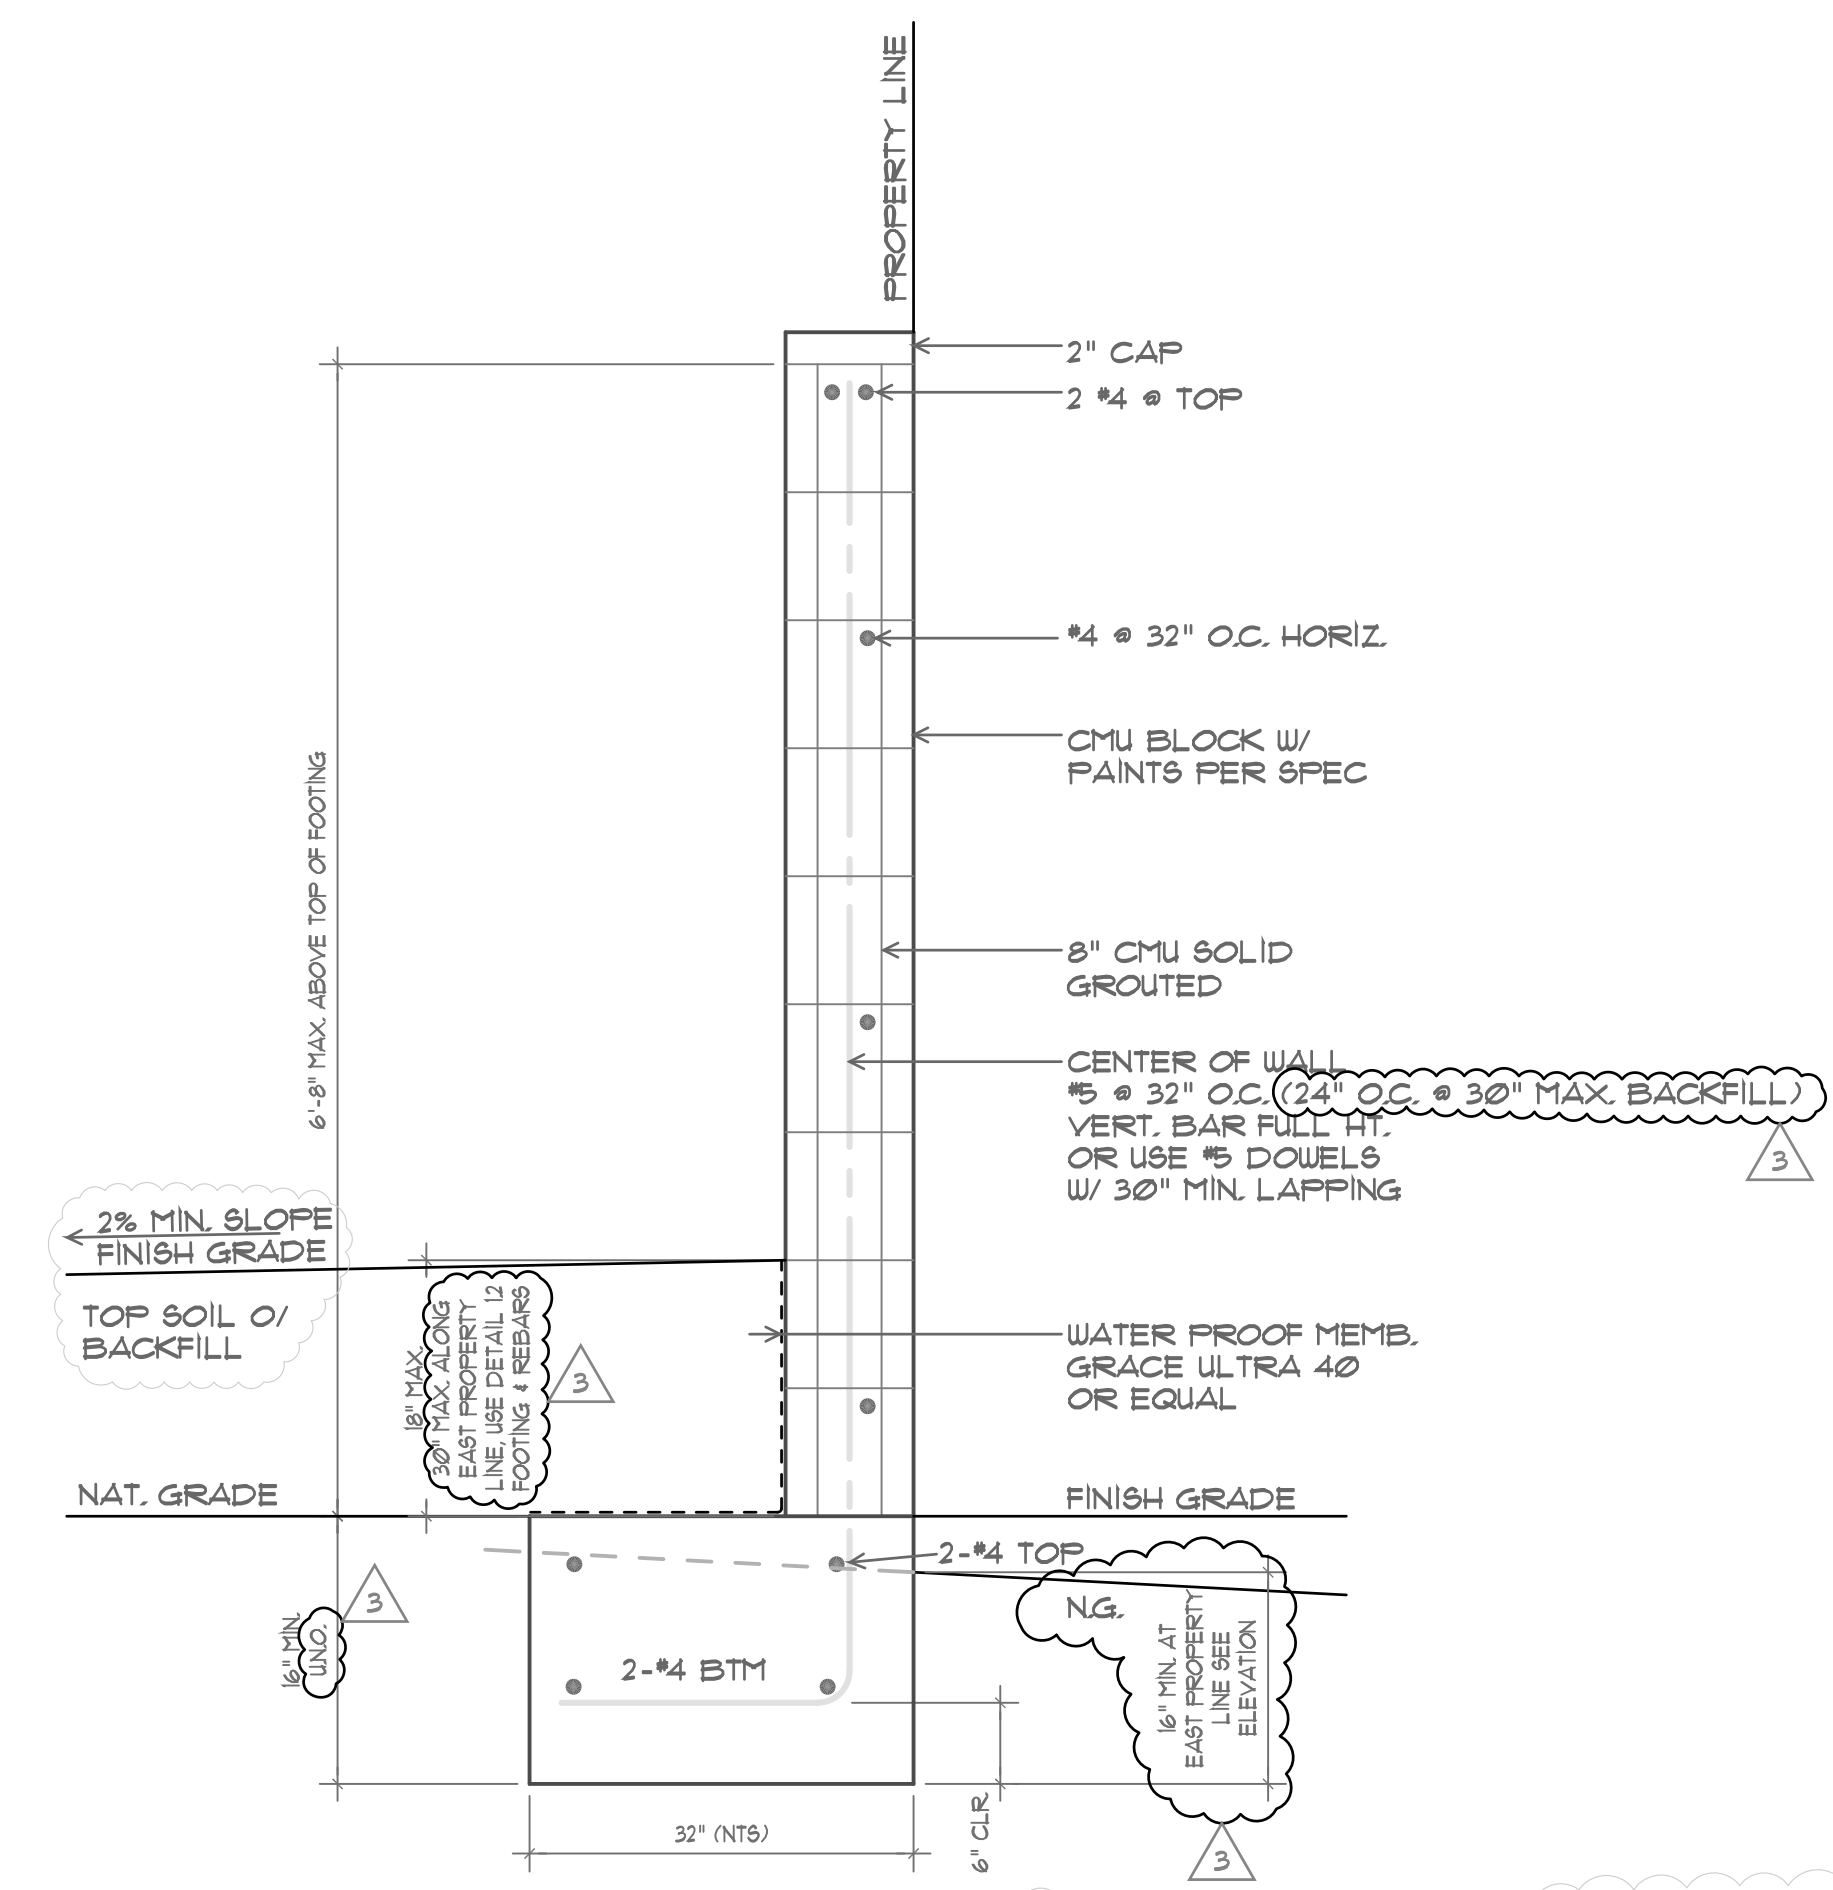


6'-8" MAX. TALL CMU FENCE  
SCALE: 1"=1'-0"

DELETED CMU FENCE RETAINING WALL & FTG  
SCALE: 1"=1'-0"

AD3-33  
03 AUG. 2010  
19 MAR. 2010  
23 DEC. 2009

CMU FENCE ELEVATIONS & DETAILS

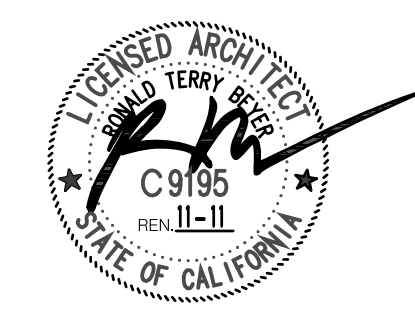

THE DESIGNS AND DRAWINGS BY RONALD BEYER, ARCHITECT IS COPYRIGHTED AS CREATED. THEY ARE PROTECTED UNDER THE 1990 ARCHITECTURAL WORKS COPYRIGHT PROTECTION ACT. THE DRAWINGS AND DESIGNS CREATED UNDER THIS AGREEMENT MAY NOT BE REPRODUCED OR USED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF RONALD BEYER, ARCHITECT.  
© RONALD BEYER, ARCHITECT 2010.